



2018 WATER QUALITY REPORT




Dear Customers,
We are providing you with Hamtramck's 2018 annual Consumer Confidence Report (CCR) for your information. Our water is supplied by the Great Lakes Water Authority, GLWA. The GLWA operates the City of Detroit's water system, formerly DWSD. The GLWA water quality is considered one of the best in the world. This report has been mailed to all customers. The report is also available on the Hamtramck website www.hamtramck.us and at City Hall.

SOURCES OF WATER

Your source water comes from the Detroit River, situated within the Lake St. Clair, Clinton River, Detroit River, Rouge River, Ecorse River, watersheds in the U.S. and parts of the Thames River, Little River, Turkey Creek and Sydenham watersheds in Canada. The Michigan Department of Environmental Quality in partnership with the U.S. Geological Survey, the Detroit Water and Sewerage Department, and the Michigan Public Health Institute performed a source water assessment in 2004 to determine the susceptibility of GLWA's Detroit River source water for potential contamination. The susceptibility rating is based on a seven-tiered scale and ranges from very low to very high determined primarily using geologic sensitivity, water chemistry, and potential contaminant sources. The report described GLWA's Detroit river intakes as highly susceptible to potential contamination. However, all four GLWA water treatment plants that service the city of Detroit and draw water from the Detroit River have historically provided satisfactory treatment and meet drinking

water standards. GLWA has initiated source-water protection activities that include chemical containment, spill response, and a mercury reduction program. GLWA participates in the National Pollutant Discharge Elimination System permit discharge program and has an emergency response management plan. In 2016, the Michigan Department of Environmental Quality approved the GLWA Surface Water Intake Protection Program plan. The programs include seven elements that include the following: roles and duties of government units and water supply agencies, delineation of a source water protection areas, identification of potential sources of contamination, management approaches for protection, contingency plans, siting of new water sources, public participation and public education activities. If you would like to know more information about the Source Water Assessment report please, contact GLWA at (313 926-8102).

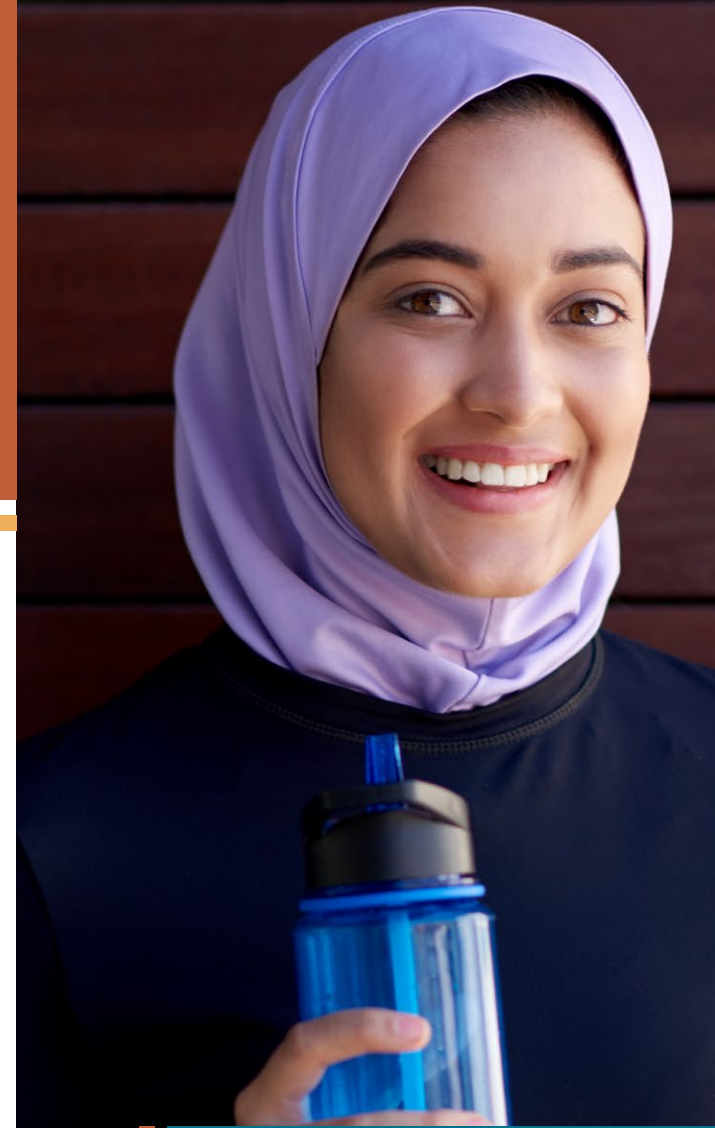

Lead Testing Results for Year 2018

The City of Hamtramck conducted Lead and Copper testing at random locations in September 2018, as required by the Michigan Department of Environmental Quality (MDEQ). The collected water samples were tested by an approved State of Michigan Lab.

The results of the tests are shown in the table below.

What Happened? What is Being Done?

Every three years, the City of Hamtramck conducts testing of the tap water in the homes for lead and copper. Per the Michigan Department of Environmental Quality (MDEQ), samples are collected from homes that are likely to have lead service lines or copper plumbing with lead solder. Our test results from five homes showed samples over the Action Level for lead in two of those homes.

The City of Hamtramck has conducted additional lead monitoring of the water system. Over 700 tests were completed by December 2018 and confirmed that the lead levels in the water are below the state's allowable limits. We are also required to test a minimum of 120 homes in 2019 to confirm that the lead levels throughout the city remain below the state's allowable limits.

To reduce exposure to lead in drinking water:

- **Run your water to flush out lead.** Run the water until it becomes cold.
- **Use cold water for cooking and preparing baby formula.** Do not cook with or drink water from the hot water tap; lead dissolves more easily in hot water.
- **Do not boil water to remove lead.** Boiling water will not reduce lead levels.
- **Identify if your plumbing fixtures contain lead.** New faucets, fittings, and valves, may contain up to 0.25 percent lead including those advertised or labeled as "lead-free" and may contribute lead to drinking water. Consumers should be aware of this when choosing fixtures and take appropriate precautions.

Although the primary sources of lead exposure for most children are deteriorating lead-based paint, lead-contaminated dust, and lead-contaminated soil, the U.S. EPA estimates that 10 to 20 percent of human exposure to lead may come from drinking water. For more information on reducing lead exposure around your home and the health effects of lead, visit the U.S. EPA's Web site at www.epa.gov/lead, call the National Lead Information Center at 800-424-LEAD, or contact your health care provider.

Key to Table	Contaminant	AL	MCLG	Hamtramck Results
Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that the water system must follow.	Lead (ppb)	15	0	28
Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.	Copper (ppb)	1300	1300	200
PPB: parts per billion				

CITY OF HAMTRAMCK CONTACT INFORMATION

Rodney Johnson, Director of Public Services
 Phone # (313) 800-5233
 Email rjohnson@hamtramckcity.com
 Visit our website at www.hamtramck.us

PUBLIC INFORMATION PARTICIPATION

The City of Hamtramck holds regular City Council meetings on the 2nd and 4th Tuesday of the month.

Water Works Park Water Treatment Plant - 2018 Regulated Detected Contaminants Tables

2018 Inorganic Chemicals – Monitoring at the Plant Finished Water Tap								
Regulated Contaminant	Test Date	Unit	Health Goal MCLG	Allowed Level MCL	Highest Level Detected	Range of Detection	Violation yes/no	Major Sources in Drinking Water
Fluoride	6-12-2018	ppm	4	4	0.75	n/a	no	Erosion of natural deposits; Water additive, which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate	6-12-2018	ppm	10	10	0.43	n/a	no	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Barium	5-16-2017	ppm	2	2	0.01	n/a	no	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits

2018 Disinfection By-Products – Monitoring in Distribution System, Stage 2 Disinfection By-Products								
Regulated Contaminant	Test Date	Unit	Health Goal MCLG	Allowed Level MCL	Highest LRAA	Range of Detection	Violation yes/no	Major Sources in Drinking Water
Total Trihalomethanes (TTHM)	2018	ppb	n/a	80	20	6.3 – 46	no	By-product of drinking water chlorination
Haloacetic Acids (HAA5)	2018	ppb	n/a	60	13	7 – 15	no	By-product of drinking water chlorination
Regulated Contaminant	Test Date	Unit	Health Goal MCLG	Allowed Level MCL	Highest RAA	Range of Detection	Violation yes/no	Major Sources in Drinking Water
Bromate	2018	ppb	0	10	0.7	0.0-2.8	no	By-product of drinking water ozone disinfection

2018 Disinfectant Residuals – Monitoring in Distribution System by Treatment Plant								
Regulated Contaminant	Test Date	Unit	Health Goal MRDLG	Allowed Level MRDL	Highest RAA	Quarterly Range of Detection	Violation yes/no	Major Sources in Drinking Water
Total Chlorine Residual	Jan-Dec 2018	ppm	4	4	0.84	0.72-0.85	no	Water additive used to control microbes

2018 Turbidity – Monitored every 4 hours at Plant Finished Water				
Highest Single Measurement Cannot exceed 1 NTU	Lowest Monthly % of Samples Meeting Turbidity Limit of 0.3 NTU (minimum 95%)	Violation yes/no	Major Sources in Drinking Water	
0.29 NTU	100%	no	Soil Runoff	

Turbidity is a measure of the cloudiness of water. We monitor it because it is a good indicator of the effectiveness of our filtration system.

Regulated Contaminant	Treatment Technique 2018	Typical Source of Contaminant
Total Organic Carbon (ppm)	The Total Organic Carbon (TOC) removal ratio is calculated as the ratio between the actual TOC removal and the TOC removal requirements. The TOC was measured each quarter and because the level was low, there is no TOC removal requirement	Erosion of natural deposits

2018 Lead and Copper Monitoring at Customers' Tap								
Regulated Contaminant	Test Date	Unit	Health Goal MCLG	Action Level AL	90 th Percentile Value*	Number of Samples over AL	Violation yes/no	Major Sources in Drinking Water
Lead	2018	ppb	0	15	28	5	yes	Corrosion of household plumbing system; Erosion of natural deposits.
Copper	2018	ppb	1300	1300	200	5	no	Corrosion of household plumbing system; Erosion of natural deposits; Leaching from wood preservatives.

*The 90th percentile value means 90 percent of the homes tested have lead and copper levels below the given 90th percentile value. If the 90th percentile value is above the AL additional requirements must be met.

Contaminant	MCLG	MCL	Level Detected 2018	Source of Contamination
Sodium (ppm)	n/a	n/a	5.76	Erosion of natural deposits

GLWA voluntarily monitors for Cryptosporidium and Giardia in our untreated source water monthly. The March 2018 untreated water samples collected from the Belle Isle intake indicated the presence of one Giardia cyst. All other samples collected from the Belle Isle intake in the year 2018 were absent for the presence of Cryptosporidium and Giardia. Systems using surface water like GLWA must provide treatment so that 99.9 percent of Giardia lamblia is removed or inactivated.

KEY TO THE DETECTED CONTAMINANTS TABLE

Symbol	Abbreviation	Definition/Explanation
>	Greater than	
°C	Celsius	A scale of temperature in which water freezes at 0° and boils at 100° under standard conditions.
AL	Action Level	the concentration of a contaminant, which, if exceeded, triggers treatment or other requirements which a water system must follow.
HAA5	Haloacetic Acids	HAA5 is the total of bromoacetic, chloroacetic, Dibromoacetic, dichloroacetic, and trichloroacetic acids. Compliance is based on the total.
Level 1	Level 1 Assessment	A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in the water system.
Level 2	Level 2 Assessment	A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.
LRAA	Locational Running Annual Average	The average of analytical results for samples at a particular monitoring location during the previous four quarters.
MCL	Maximum Contaminant Level	The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.
MCLG	Maximum Contaminant Level Goal	The level of contaminant in drinking water below which there is no known or expected risk to health.
MRDL	Maximum Residual Disinfectant Level	The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
MRDLG	Maximum Residual Disinfectant Level Goal	The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLG's do not reflect the benefits of the use of disinfectants to control microbial contaminants.
n/a	not applicable	
ND	Not Detected	
NTU	Nephelometric Turbidity Units	Measures the cloudiness of water.
pCi/L	Picocuries Per Liter	A measure of radioactivity
ppb	Parts Per Billion (one in one billion)	The ppb is equivalent to micrograms per liter. A microgram = 1/1000 milligram.
ppm	Parts Per Million (one in one million)	The ppm is equivalent to milligrams per liter. A milligram = 1/1000 gram.
RAA	Running Annual Average	The average of analytical results for all samples during the previous four quarters.
TT	Treatment Technique	A required process intended to reduce the level of a contaminant in drinking water.
TTHM	Total Trihalomethanes	Total Trihalomethanes is the sum of chloroform, bromodichloromethane, dibromochloromethane and bromoform. Compliance is based on the total.
µohms	Microhms	Measure of electrical conductance of water

SAFE DRINKING WATER IS ALL OUR RESPONSIBILITY

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline at (800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

- Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.

- Organic chemical contaminants, including synthetic and volatile organics, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff and septic systems.

- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.


In order to ensure that tap water is safe to drink, EPA prescribes regulations, which limit the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

Warning about the vulnerability of some populations to contaminants in drinking water.

Some people may be more vulnerable to contaminants in drinking water than is the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and flush your tap for 30 seconds to 2 minutes before using tap water. Additional information is available from the Safe Drinking Water Hotline (800-426-4791).

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Hamtramck is responsible for providing high quality drinking water but, cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

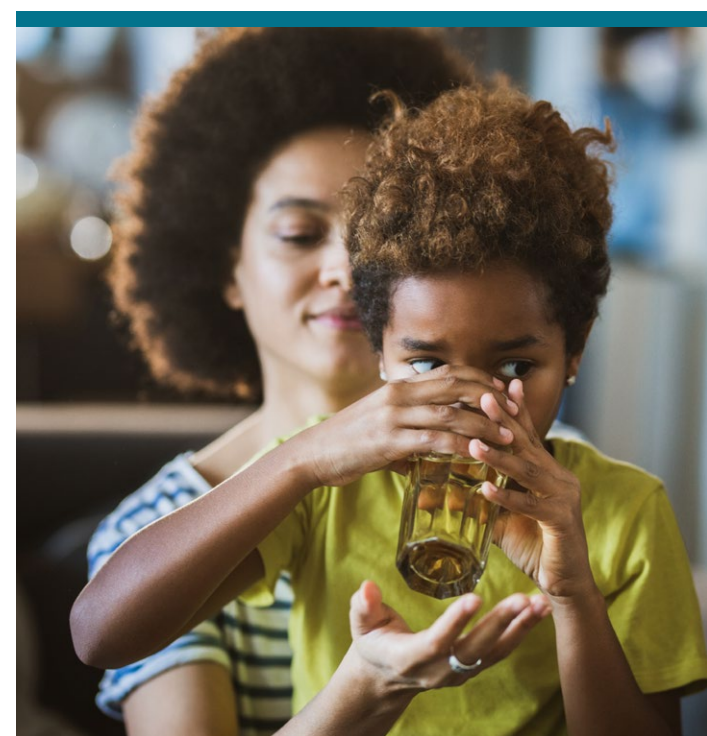

WORKING HARD TO BRING EXCEPTIONAL WATER TO YOU!


Drinking water quality is important to our community and the region.



The City of Hamtramck and the Great Lakes Water Authority (GLWA) are committed to meeting state and federal water quality standards including the Lead and Copper Rule. With the Great Lakes as our water source and proven treatment technologies, the GLWA consistently delivers safe drinking water to our community. Hamtramck operates the system of water mains that carry this water to your home's service line. This year's Water Quality Report highlights the performance of GLWA and Hamtramck water professionals in delivering some of the nation's best drinking water. Together, we remain committed to protecting public health and maintaining open communication with the public about our drinking water.

Hamtramck and the Great Lakes Water Authority are committed to safeguarding our water supply and delivering the highest quality drinking water to protect public health. Please contact us with any questions or concerns about your water.

Safe drinking water is a shared responsibility. The water that GLWA delivers to our community does not contain lead. Lead can leach into drinking water through home plumbing fixtures, and in some cases, customer service lines. Corrosion control reduces the risk of lead and copper from leaching into your water. Orthophosphates are added during the treatment process as a corrosion control method to create a protective coating in service pipes throughout the system, including in your home or business. The City of Hamtramck performs required lead and copper sampling and testing in our community. Water consumers also have a responsibility to maintain the plumbing in their homes and businesses, and can take steps to limit their exposure to lead.

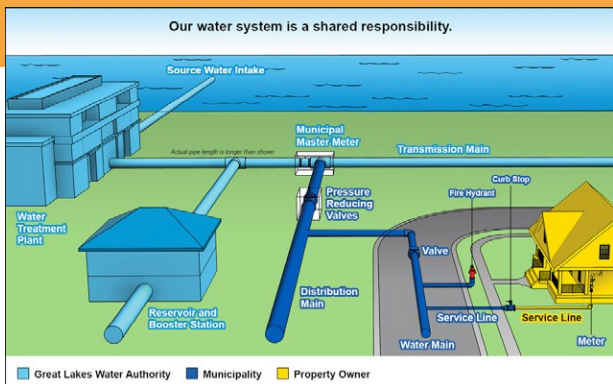

Source: Water Quality Work Group.

This messaging was developed collaboratively between GLWA and its wholesale water customers as part of the GLWA Customer Outreach effort in 2016.

Diagrams: Water system diagrams showing various pipe ownership scenarios are available at:

<http://www.glwawater.org/water-system/water-quality-matters/water-quality-report-collaborative-messaging-and-diagrams/>